
# LUMINAIRE PHOTOMETRIC TEST REPORT

| | | |
|---|---|---|
| Test:U:230.0V I:0.227A P:50.0W PF:0.957 Freq:50.00Hz<br>UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:7367.48x1 lm | | |
| NAME: LHB13-050-4080-L00C182 | TYPE: | WEIGHT: |
| SPEC.: | DIM.: | SERIAL No.: |
| MFR.: | SUR.: | Shielding Angle: |


| DATA OF LAMP | | PHOTOMETRIC DATA Eff: 147.35 lm/W | | | |
|---|---|---|---|---|---|
| MODEL | / | Imax(cd) | 2042 | S/MH(C0/180) | 1.24 |
| NOMINAL POWER(W) | / | LOR(%) | 100.0 | S/MH(C90/270) | 1.30 |
| RATED VOLTAGE(V) | / | TOTAL FLUX(lm) | 7367.5 | η UP,DN(C0-180) | 4.9,45.1 |
| NOMINAL FLUX(lm) | 7367.48 | CIE CLASS | DIRECT | η UP,DN(C180-360) | 4.9,45.1 |
| LAMPS INSIDE | 1 | η up(%) | 9.7 | CIBSE SHR NOM | 1.25 |
| TEST VOLTAGE(V) | / | η down(%) | 90.3 | CIBSE SHR MAX | 1.35 |

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

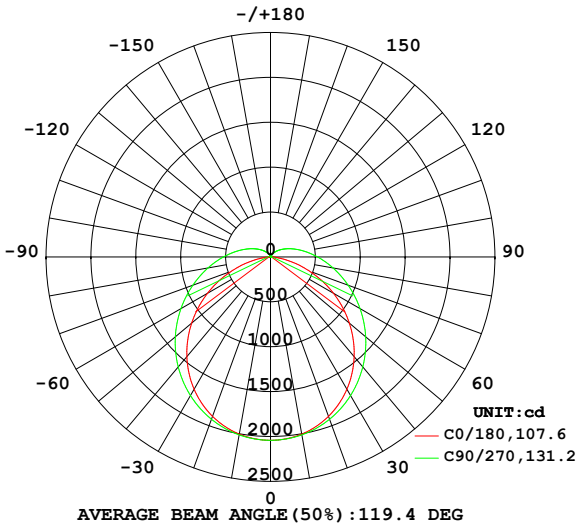


AVERAGE BEAM ANGLE(50%):119.4 DEG

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

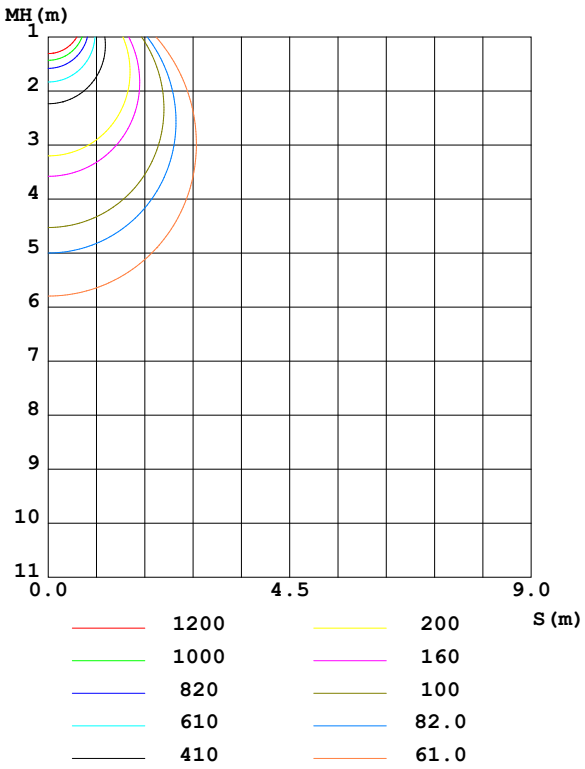


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

# ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

| γ | C0 | C45 | C90 | C135 | C180 | C225 | C270 | C315 | γ | Φ zone | Φ total | %lum,lamp |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 10 | 2004 | 2008 | 2012 | 2008 | 2004 | 2008 | 2012 | 2008 | 0- 10 | 193.3 | 193.3 | 2.62,2.62 |
| 20 | 1889 | 1907 | 1924 | 1907 | 1889 | 1907 | 1924 | 1907 | 10- 20 | 554.8 | 748.1 | 10.2,10.2 |
| 30 | 1702 | 1744 | 1783 | 1744 | 1702 | 1744 | 1783 | 1744 | 20- 30 | 844.5 | 1593 | 21.6,21.6 |
| 40 | 1449 | 1530 | 1599 | 1530 | 1449 | 1530 | 1599 | 1530 | 30- 40 | 1027 | 2619 | 35.6,35.6 |
| 50 | 1146 | 1281 | 1384 | 1281 | 1146 | 1281 | 1384 | 1281 | 40- 50 | 1083 | 3702 | 50.3,50.3 |
| 60 | 810.1 | 1018 | 1152 | 1018 | 810.1 | 1018 | 1152 | 1018 | 50- 60 | 1017 | 4720 | 64.1,64.1 |
| 70 | 461.9 | 765.0 | 920.3 | 765.0 | 461.9 | 765.0 | 920.3 | 765.0 | 60- 70 | 855.2 | 5575 | 75.7,75.7 |
| 80 | 158.1 | 541.9 | 707.2 | 541.9 | 158.1 | 541.9 | 707.2 | 541.9 | 70- 80 | 642.1 | 6217 | 84.4,84.4 |
| 90 | 7.238 | 364.1 | 524.1 | 364.1 | 7.238 | 364.1 | 524.1 | 364.1 | 80- 90 | 435.6 | 6653 | 90.3,90.3 |
| 100 | 20.10 | 235.4 | 377.7 | 235.4 | 20.10 | 235.4 | 377.7 | 235.4 | 90-100 | 287.4 | 6940 | 94.2,94.2 |
| 110 | 14.46 | 148.4 | 264.4 | 148.4 | 14.46 | 148.4 | 264.4 | 148.4 | 100-110 | 186.5 | 7127 | 96.7,96.7 |
| 120 | 10.80 | 91.74 | 178.2 | 91.74 | 10.80 | 91.74 | 178.2 | 91.74 | 110-120 | 114.6 | 7241 | 98.3,98.3 |
| 130 | 7.379 | 55.23 | 113.9 | 55.23 | 7.379 | 55.23 | 113.9 | 55.23 | 120-130 | 66.45 | 7308 | 99.2,99.2 |
| 140 | 5.041 | 32.51 | 67.68 | 32.51 | 5.041 | 32.51 | 67.68 | 32.51 | 130-140 | 35.14 | 7343 | 99.7,99.7 |
| 150 | 3.281 | 16.82 | 35.88 | 16.82 | 3.281 | 16.82 | 35.88 | 16.82 | 140-150 | 16.35 | 7359 | 99.9,99.9 |
| 160 | 2.782 | 8.928 | 15.30 | 8.928 | 2.782 | 8.928 | 15.30 | 8.928 | 150-160 | 6.170 | 7365 | 100,100 |
| 170 | 2.554 | 2.815 | 5.807 | 2.815 | 2.554 | 2.815 | 5.807 | 2.815 | 160-170 | 1.805 | 7367 | 100,100 |
| 180 | 3.130 | 3.084 | 2.482 | 3.084 | 3.130 | 3.084 | 2.482 | 3.084 | 170-180 | 0.2701 | 7367 | 100,100 |
| DEG | LUMINOUS INTENSITY:cd | | | | | | | | | UNIT:lm | | |

Conical surface Flux(90deg): 3161.8 lm

%lum = 42.9%
%lamp = 42.9%

Conical surface Flux(120deg): 4719.9 lm

%lum = 64.1%
%lamp = 64.1%


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

# LUMINANCE LIMITATION CURVES

**LUMINANCE LIMITATION CURVES**

| GLARE | CLASS | ILLUMINANCE (lx) | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| 1.15 | A | 2000 | 1000 | 500 | <=300 | | | | |
| 1.50 | B | | 2000 | 1000 | 500 | <=300 | | | |
| 1.85 | C | | | 2000 | 1000 | 500 | <=300 | | |
| 2.20 | D | | | | 2000 | 1000 | 500 | <=300 | |
| 2.55 | E | | | | | 2000 | 1000 | 500 | <=300 |
| | | a | b | c | d | e | f | g | h |

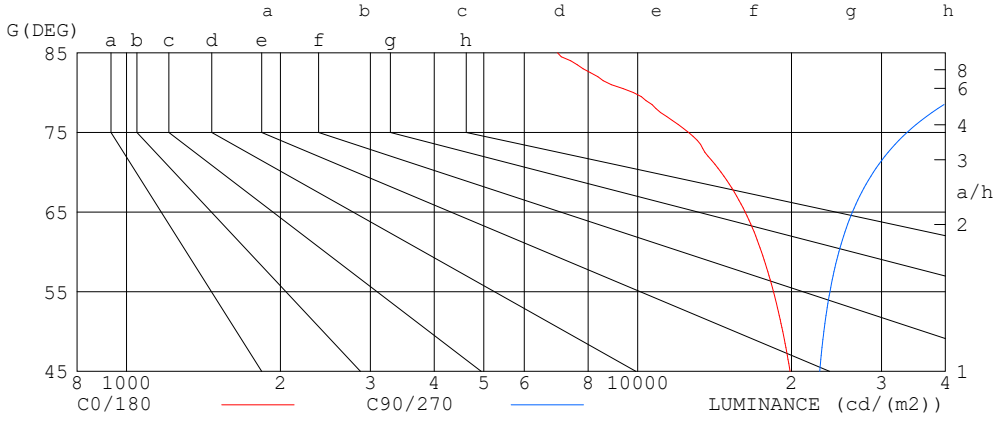


| LUMINANCE cd/(m2) | | |
|---|---|---|
| G(DEG) | C0/180 | C90/270 |
| 85 | 6971 | 75362 |
| 80 | 9817 | 43772 |
| 75 | 12580 | 33666 |
| 70 | 14562 | 28919 |
| 65 | 16233 | 26317 |
| 60 | 17468 | 24761 |
| 55 | 18444 | 23783 |
| 50 | 19226 | 23140 |
| 45 | 19871 | 22713 |

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03


γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

# CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

| ρcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| ρw | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| ρfc | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| RCR | RCR:Room Cavity Ratio | | | Coefficients of Utilization(CU) | | | | | | | | | | | | |
| 0.0 | 1.17 | 1.17 | 1.17 | 1.13 | 1.13 | 1.13 | 1.06 | 1.06 | 1.06 | .99 | .99 | .99 | .93 | .93 | .93 | .90 |
| 1.0 | .99 | .94 | .89 | .96 | .91 | .87 | .89 | .86 | .82 | .84 | .81 | .78 | .79 | .76 | .74 | .71 |
| 2.0 | .85 | .78 | .71 | .82 | .75 | .70 | .77 | .71 | .67 | .72 | .68 | .64 | .68 | .64 | .61 | .58 |
| 3.0 | .74 | .65 | .58 | .72 | .64 | .57 | .67 | .61 | .55 | .63 | .58 | .53 | .60 | .55 | .51 | .48 |
| 4.0 | .65 | .56 | .49 | .63 | .55 | .48 | .60 | .52 | .46 | .56 | .50 | .45 | .53 | .48 | .43 | .41 |
| 5.0 | .58 | .49 | .42 | .57 | .48 | .41 | .53 | .46 | .40 | .50 | .44 | .39 | .47 | .42 | .37 | .35 |
| 6.0 | .52 | .43 | .36 | .51 | .42 | .36 | .48 | .40 | .35 | .45 | .39 | .34 | .43 | .37 | .33 | .30 |
| 7.0 | .47 | .38 | .32 | .46 | .38 | .32 | .44 | .36 | .31 | .41 | .35 | .30 | .39 | .33 | .29 | .27 |
| 8.0 | .43 | .34 | .28 | .42 | .34 | .28 | .40 | .33 | .27 | .38 | .31 | .27 | .36 | .30 | .26 | .24 |
| 9.0 | .39 | .31 | .25 | .38 | .31 | .25 | .37 | .29 | .25 | .35 | .28 | .24 | .33 | .27 | .23 | .21 |
| 10.0 | .36 | .28 | .23 | .35 | .28 | .23 | .34 | .27 | .22 | .32 | .26 | .22 | .31 | .25 | .21 | .19 |

LAMPS

LUMINAIRE BUDGETARY DIAGRAM

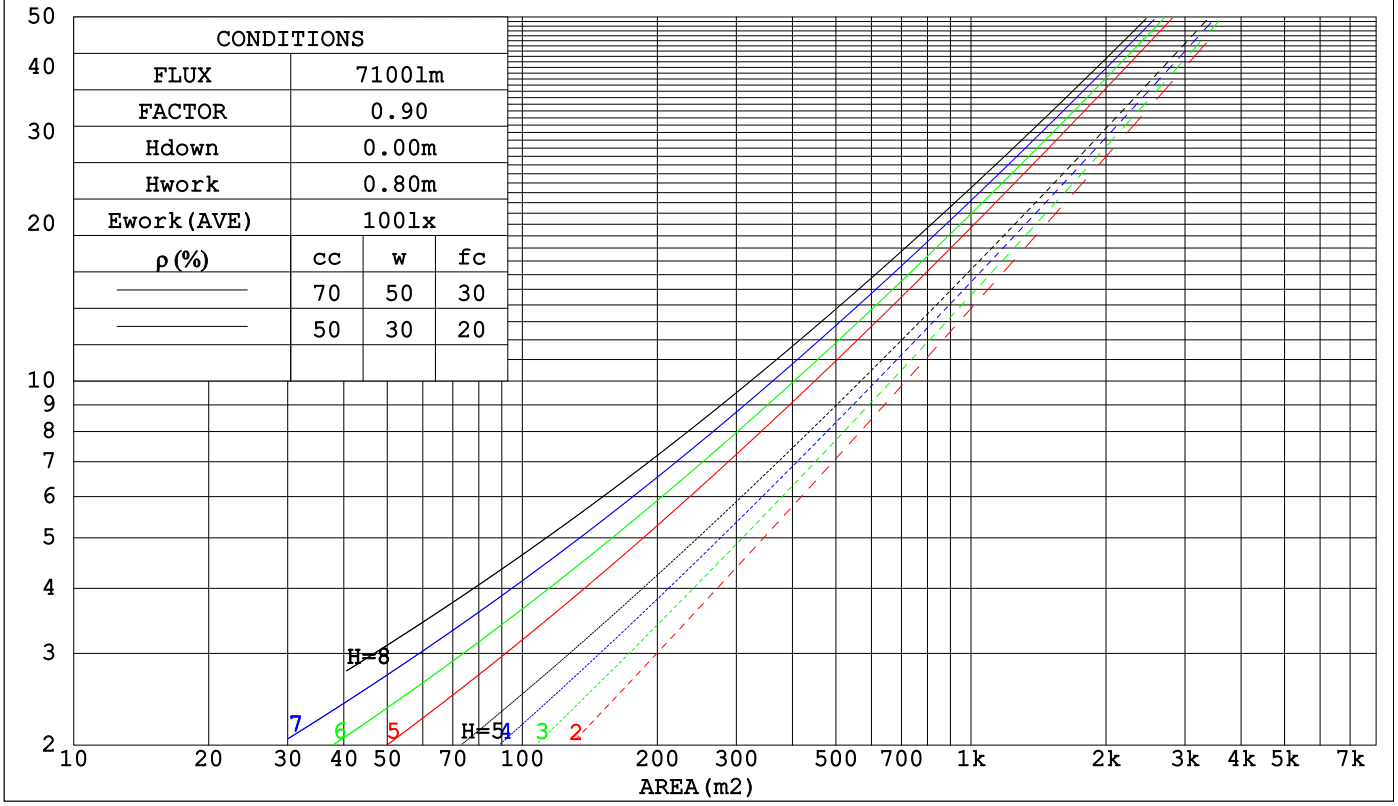


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

## WEC AND CCEC

| ρcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| ρw | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| ρfc | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| RCR | RCR:Room Cavity Ratio | | | | | | Wall Exitance Coeffcients(WEC) | | | | | | | | | |
| 0.0 | | | | | | | | | | | | | | | | |
| 1.0 | .362 | .206 | .065 | .352 | .201 | .064 | .333 | .191 | .061 | .315 | .182 | .058 | .299 | .173 | .056 | |
| 2.0 | .320 | .176 | .054 | .311 | .171 | .053 | .294 | .164 | .051 | .278 | .156 | .049 | .264 | .149 | .047 | |
| 3.0 | .288 | .153 | .046 | .280 | .150 | .045 | .264 | .143 | .044 | .250 | .137 | .042 | .237 | .131 | .041 | |
| 4.0 | .261 | .136 | .040 | .254 | .133 | .039 | .240 | .127 | .038 | .227 | .122 | .037 | .215 | .117 | .036 | |
| 5.0 | .238 | .122 | .035 | .232 | .119 | .035 | .219 | .114 | .034 | .208 | .110 | .033 | .197 | .105 | .032 | |
| 6.0 | .219 | .110 | .031 | .213 | .108 | .031 | .202 | .104 | .030 | .192 | .100 | .029 | .182 | .096 | .028 | |
| 7.0 | .203 | .100 | .028 | .198 | .098 | .028 | .187 | .095 | .027 | .178 | .091 | .027 | .169 | .088 | .026 | |
| 8.0 | .189 | .092 | .026 | .184 | .090 | .026 | .174 | .087 | .025 | .166 | .084 | .024 | .158 | .081 | .024 | |
| 9.0 | .176 | .085 | .024 | .172 | .084 | .023 | .163 | .081 | .023 | .155 | .078 | .022 | .148 | .075 | .022 | |
| 10.0 | .165 | .079 | .022 | .161 | .078 | .022 | .153 | .075 | .021 | .146 | .072 | .021 | .139 | .070 | .020 | |

| ρcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| ρw | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| ρfc | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| RCR | RCR:Room Cavity Ratio | | | | | | Ceiling Cavity Exitance Coefficients(CCEC) | | | | | | | | | |
| 0.0 | .264 | .264 | .264 | .226 | .226 | .226 | .154 | .154 | .154 | .089 | .089 | .089 | .028 | .028 | .028 | |
| 1.0 | .258 | .230 | .205 | .221 | .198 | .176 | .151 | .136 | .122 | .087 | .079 | .071 | .028 | .025 | .023 | |
| 2.0 | .251 | .207 | .170 | .215 | .178 | .147 | .147 | .123 | .102 | .085 | .072 | .060 | .027 | .023 | .020 | |
| 3.0 | .243 | .190 | .147 | .209 | .164 | .128 | .143 | .114 | .090 | .083 | .066 | .053 | .027 | .022 | .017 | |
| 4.0 | .236 | .177 | .132 | .202 | .153 | .115 | .139 | .107 | .081 | .080 | .062 | .048 | .026 | .020 | .016 | |
| 5.0 | .228 | .167 | .122 | .196 | .144 | .106 | .135 | .101 | .075 | .078 | .059 | .044 | .025 | .019 | .015 | |
| 6.0 | .220 | .159 | .115 | .189 | .138 | .100 | .131 | .096 | .071 | .076 | .057 | .042 | .024 | .019 | .014 | |
| 7.0 | .213 | .152 | .109 | .184 | .132 | .095 | .127 | .092 | .067 | .074 | .054 | .040 | .024 | .018 | .013 | |
| 8.0 | .207 | .146 | .105 | .178 | .127 | .091 | .123 | .089 | .065 | .072 | .053 | .039 | .023 | .017 | .013 | |
| 9.0 | .201 | .142 | .102 | .173 | .123 | .089 | .120 | .086 | .063 | .070 | .051 | .038 | .023 | .017 | .012 | |
| 10.0 | .195 | .137 | .099 | .168 | .119 | .086 | .116 | .084 | .061 | .068 | .050 | .037 | .022 | .016 | .012 | |

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

# UGR(Unified Glare Rating) Table

| | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|
| ceiling/cavity | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| walls | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| working plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room dimensions | Viewed crosswise | | | | | Viewed endwise | | | | |
| x = 2H y = 2H | 21.1 | 22.6 | 21.6 | 23.1 | 23.6 | 22.7 | 24.2 | 23.2 | 24.7 | 25.2 |
| 3H | 22.7 | 24.1 | 23.3 | 24.6 | 25.2 | 25.3 | 26.7 | 25.8 | 27.2 | 27.8 |
| 4H | 23.3 | 24.6 | 23.9 | 25.1 | 25.7 | 26.6 | 27.9 | 27.2 | 28.5 | 29.1 |
| 6H | 23.7 | 24.9 | 24.3 | 25.5 | 26.1 | 28.0 | 29.2 | 28.6 | 29.8 | 30.4 |
| 8H | 23.8 | 25.0 | 24.4 | 25.5 | 26.2 | 28.8 | 29.9 | 29.4 | 30.5 | 31.1 |
| 12H | 23.9 | 25.0 | 24.4 | 25.5 | 26.2 | 29.6 | 30.8 | 30.2 | 31.3 | 32.0 |
| 4H 2H | 22.1 | 23.4 | 22.6 | 23.9 | 24.5 | 23.3 | 24.6 | 23.8 | 25.1 | 25.7 |
| 3H | 24.1 | 25.2 | 24.6 | 25.7 | 26.4 | 26.2 | 27.3 | 26.8 | 27.9 | 28.5 |
| 4H | 24.8 | 25.9 | 25.4 | 26.4 | 27.1 | 27.7 | 28.7 | 28.3 | 29.3 | 30.0 |
| 6H | 25.4 | 26.3 | 26.0 | 26.9 | 27.6 | 29.4 | 30.3 | 30.0 | 30.9 | 31.5 |
| 8H | 25.6 | 26.5 | 26.2 | 27.1 | 27.7 | 30.3 | 31.1 | 30.8 | 31.7 | 32.4 |
| 12H | 25.7 | 26.5 | 26.4 | 27.1 | 27.8 | 31.3 | 32.0 | 31.9 | 32.7 | 33.3 |
| 8H 4H | 25.8 | 26.6 | 26.4 | 27.2 | 27.9 | 28.1 | 29.0 | 28.7 | 29.6 | 30.3 |
| 6H | 26.7 | 27.4 | 27.3 | 28.1 | 28.7 | 30.0 | 30.8 | 30.7 | 31.4 | 32.1 |
| 8H | 27.1 | 27.7 | 27.7 | 28.4 | 29.1 | 31.1 | 31.8 | 31.8 | 32.4 | 33.1 |
| 12H | 27.3 | 27.9 | 28.0 | 28.6 | 29.3 | 32.4 | 33.0 | 33.0 | 33.6 | 34.4 |
| 12H 4H | 26.1 | 26.8 | 26.7 | 27.5 | 28.2 | 28.2 | 28.9 | 28.8 | 29.6 | 30.3 |
| 6H | 27.2 | 27.8 | 27.8 | 28.5 | 29.2 | 30.2 | 30.8 | 30.8 | 31.4 | 32.2 |
| 8H | 27.7 | 28.3 | 28.4 | 28.9 | 29.7 | 31.4 | 31.9 | 32.0 | 32.6 | 33.3 |
| CIE190: 2010 | | | | | | | | | | |
| | | | | | | | | | | |

CIE190: 2010
Area: 0.09303 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:


# UTILIZATION FACTORS TABLE

| REFLECTANCE | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|
| Ceiling | 0.8 | 0.8 | 0.8 | 0.7 | 0.7 | 0.7 | 0.5 | 0.5 | 0.5 | 0 |
| Walls | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0 |
| Working plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0 |
| ROOM INDEX | UTILIZATION FACTORS(PERCENT) k(RI) x RCR = 5 | | | | | | | | | |
| k = 0.60 | 52 | 40 | 33 | 51 | 40 | 33 | 50 | 39 | 32 | 26 |
| 0.80 | 61 | 49 | 41 | 60 | 48 | 41 | 58 | 47 | 40 | 33 |
| 1.00 | 69 | 57 | 49 | 68 | 56 | 49 | 65 | 57 | 48 | 40 |
| 1.25 | 76 | 64 | 56 | 74 | 63 | 56 | 71 | 61 | 55 | 46 |
| 1.50 | 81 | 70 | 62 | 79 | 69 | 61 | 75 | 66 | 60 | 51 |
| 2.00 | 88 | 78 | 71 | 86 | 77 | 69 | 81 | 73 | 67 | 57 |
| 2.50 | 93 | 83 | 76 | 90 | 81 | 75 | 85 | 78 | 72 | 61 |
| 3.00 | 96 | 88 | 81 | 93 | 86 | 79 | 88 | 82 | 76 | 65 |
| 4.00 | 101 | 93 | 87 | 97 | 91 | 86 | 92 | 86 | 82 | 70 |
| 5.00 | 103 | 97 | 92 | 100 | 94 | 90 | 94 | 89 | 86 | 73 |
| ROOM INDEX | UF(total) | | | | | | | | | Direct |
| According to DIN EN 13032-2 2004 | | | | Suspended | | | | | SHRNOM = 1.25 | |

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:


## ISOCANDELA DIAGRAM

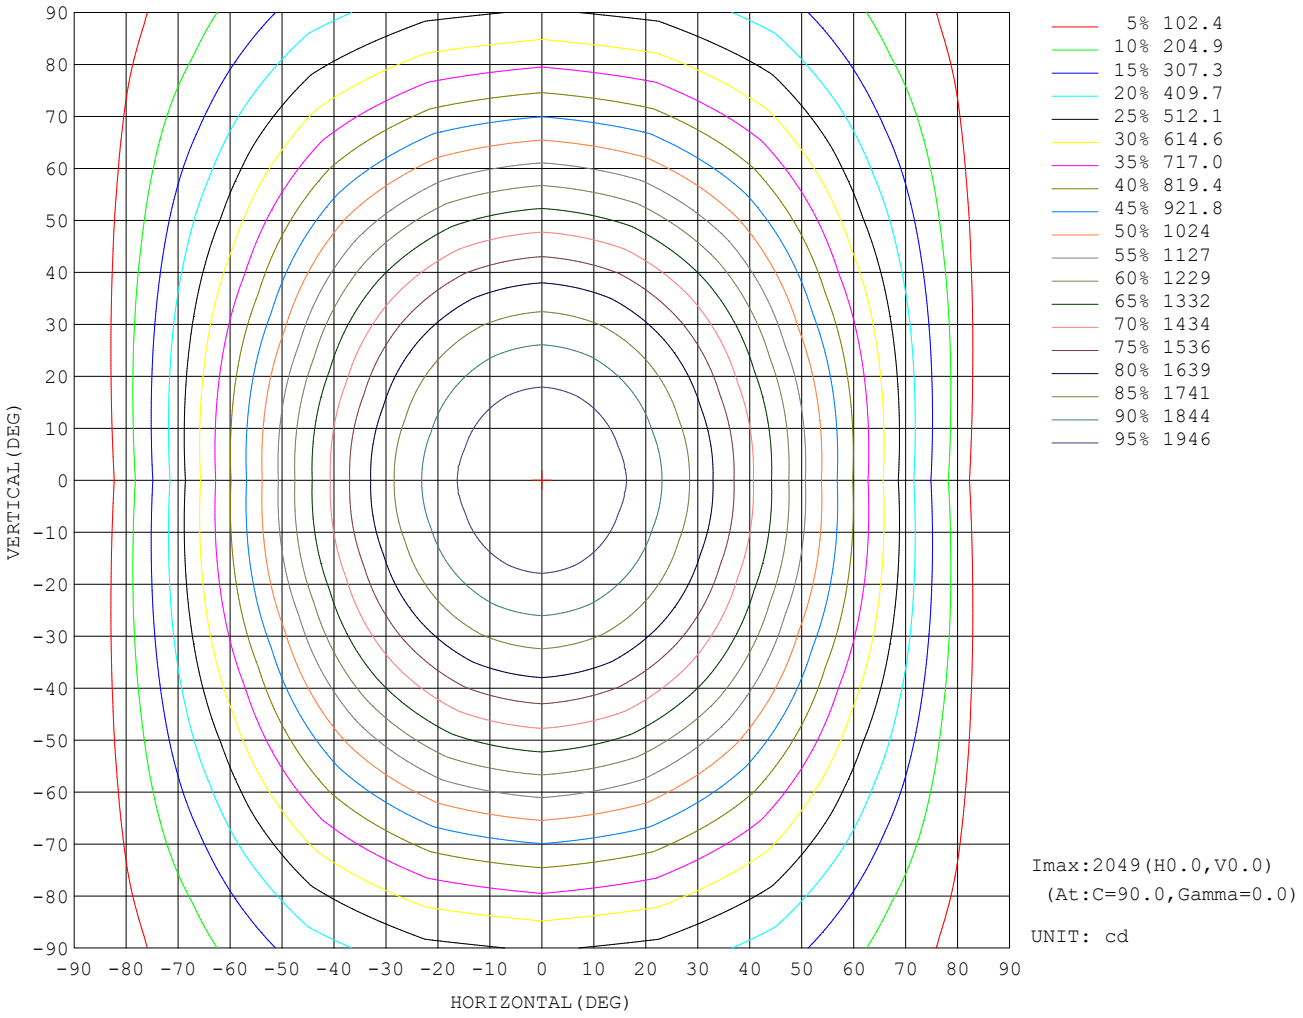


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

## AAI Figure

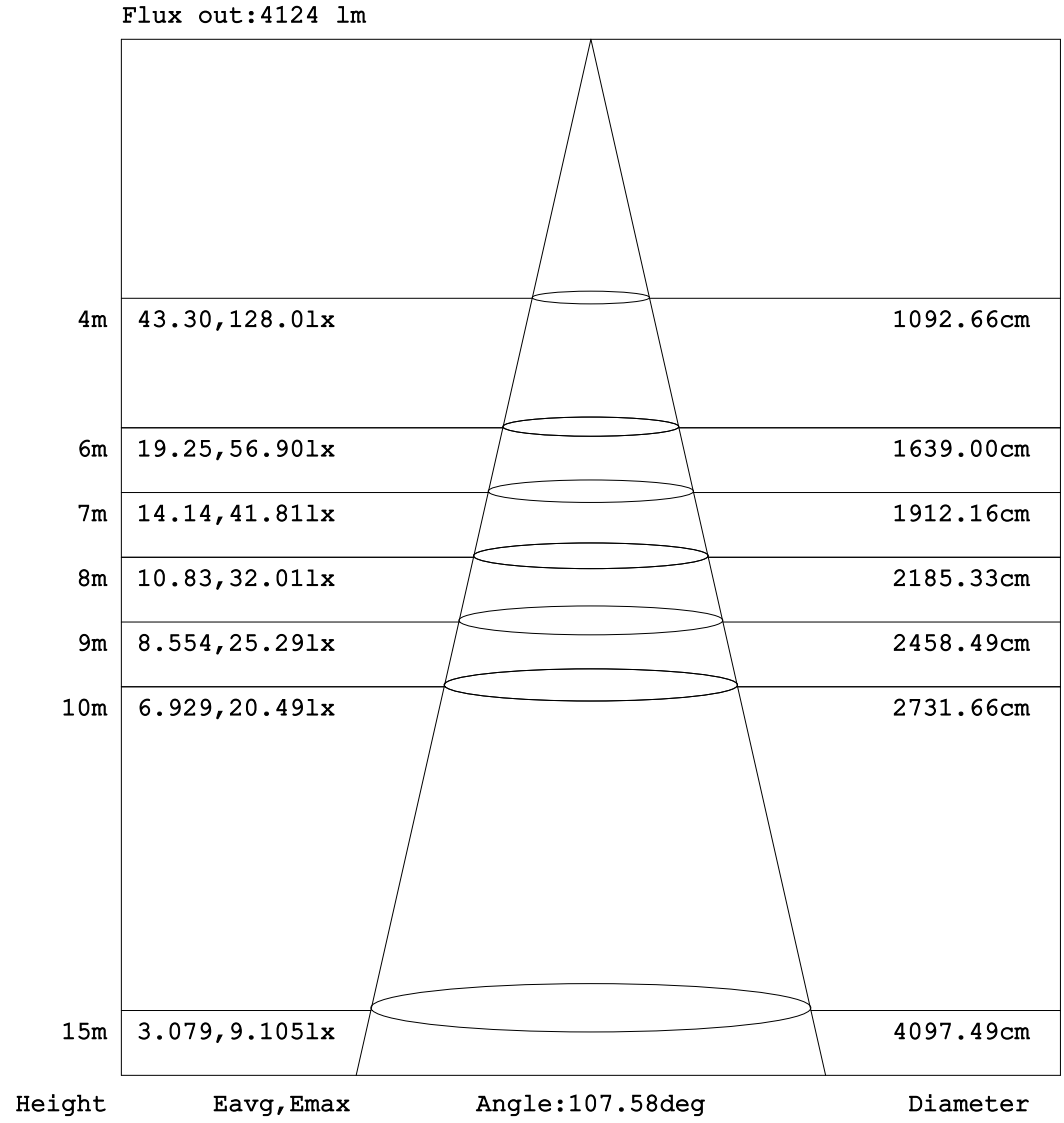



**Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.**

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:


## ISOLUX DIAGRAM

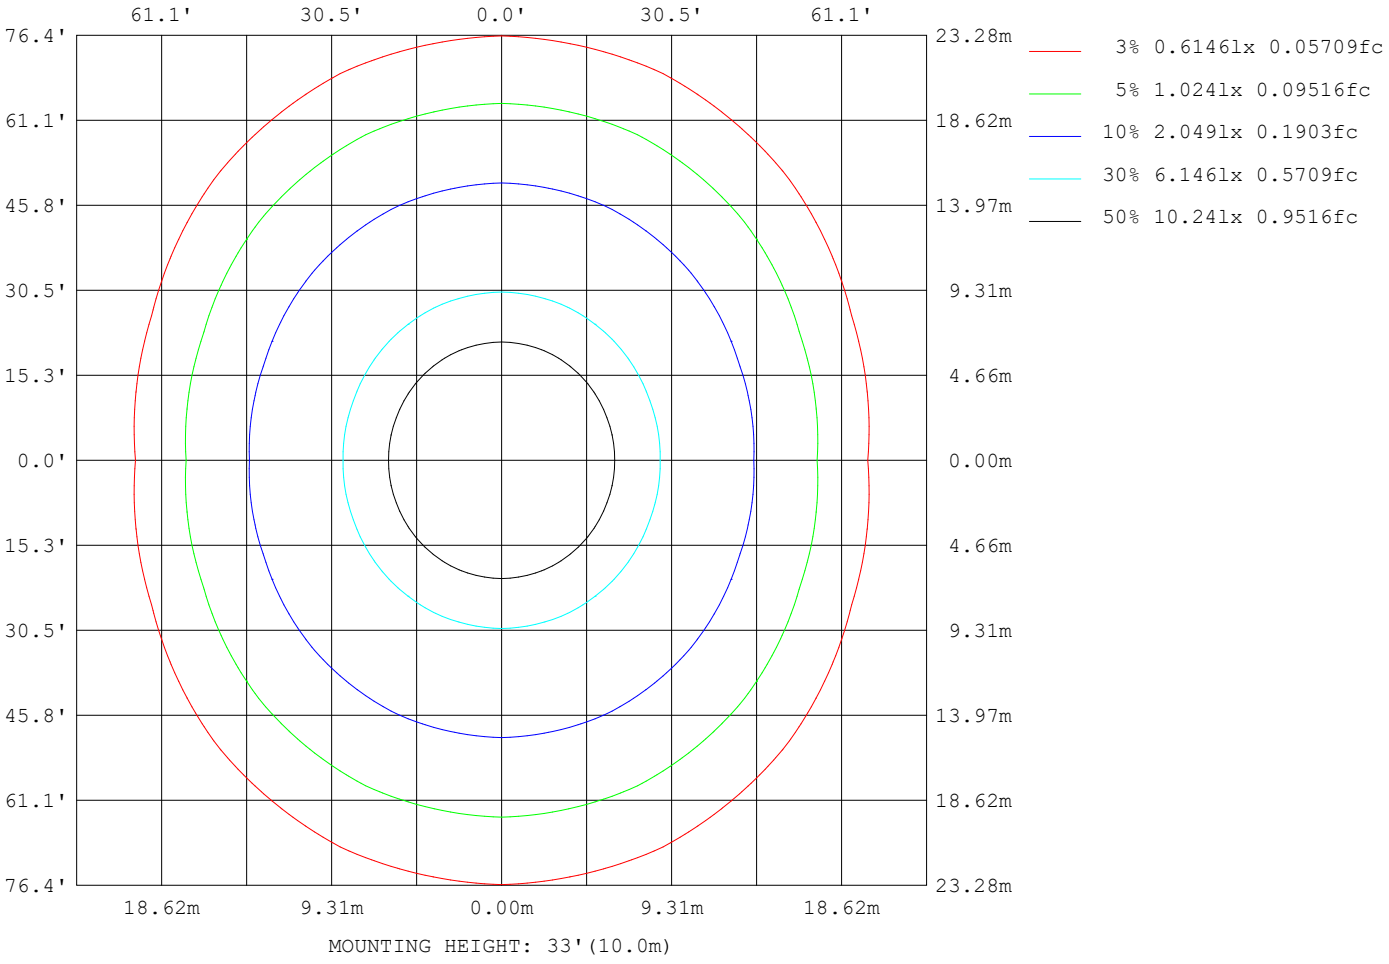


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks:

## Planar Illuminance Curve

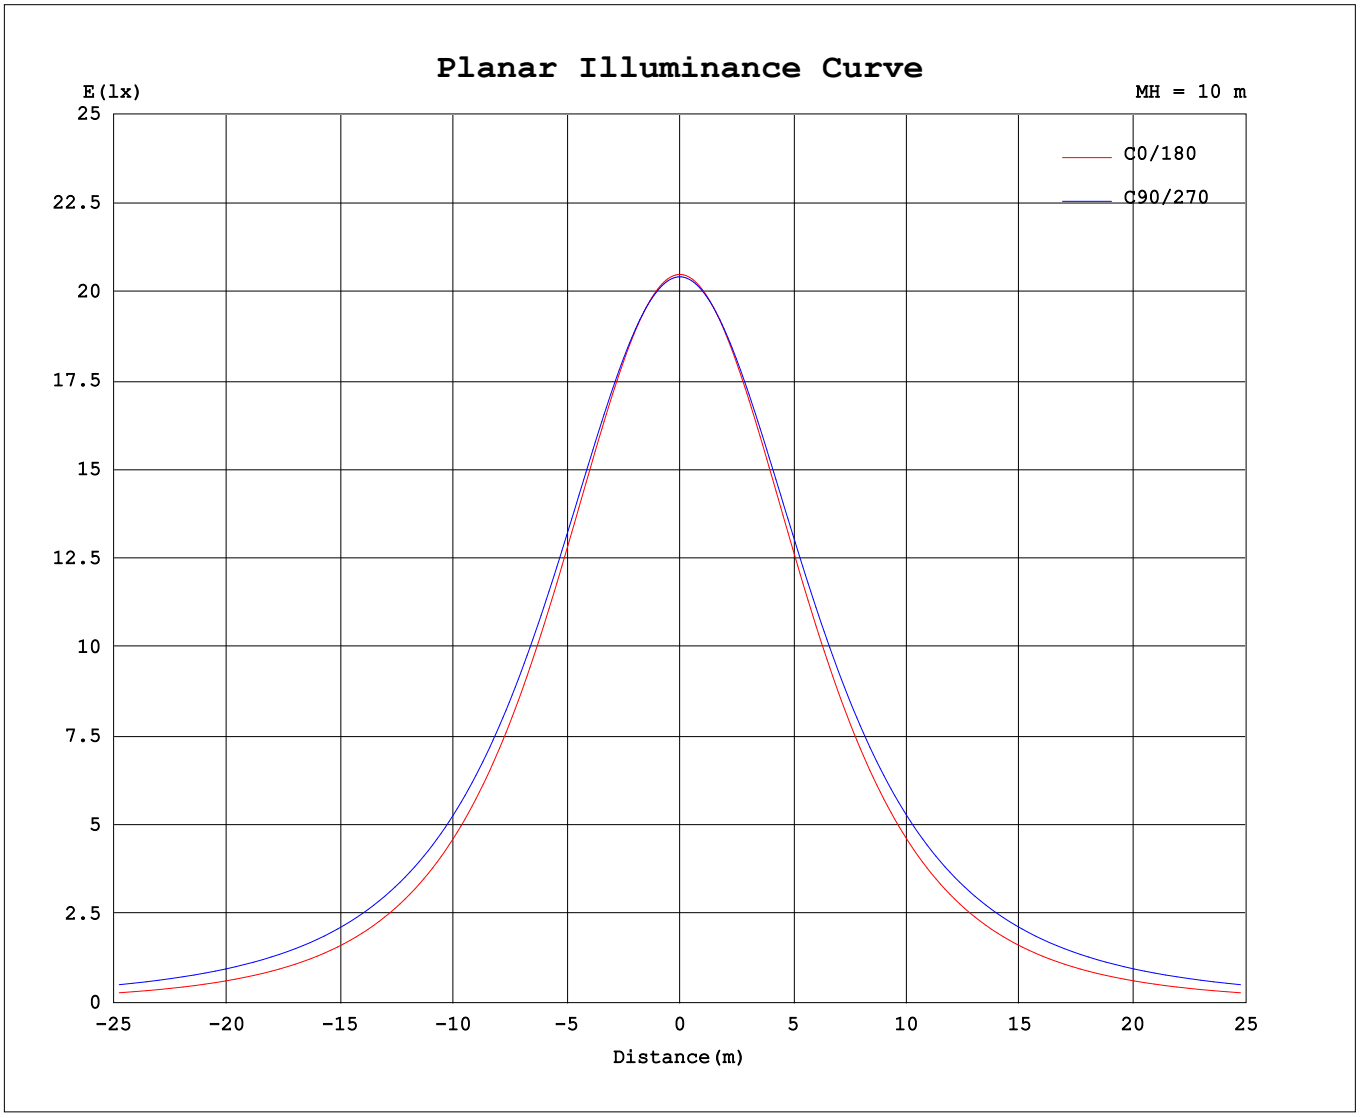


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:LYJ
Test Date:2022-05-03

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.446
Humidity:65.0%
Test Distance:26.000m [K=0.0446]
Remarks: